YORK®

Installation & Owner's Manual

MINISPLIT HIGH WALL

AIR CONDITIONER

MODELS

MLCA-MLHA 07-24
MLCB-MLHB 07-24
MACC-MAHC 07-24

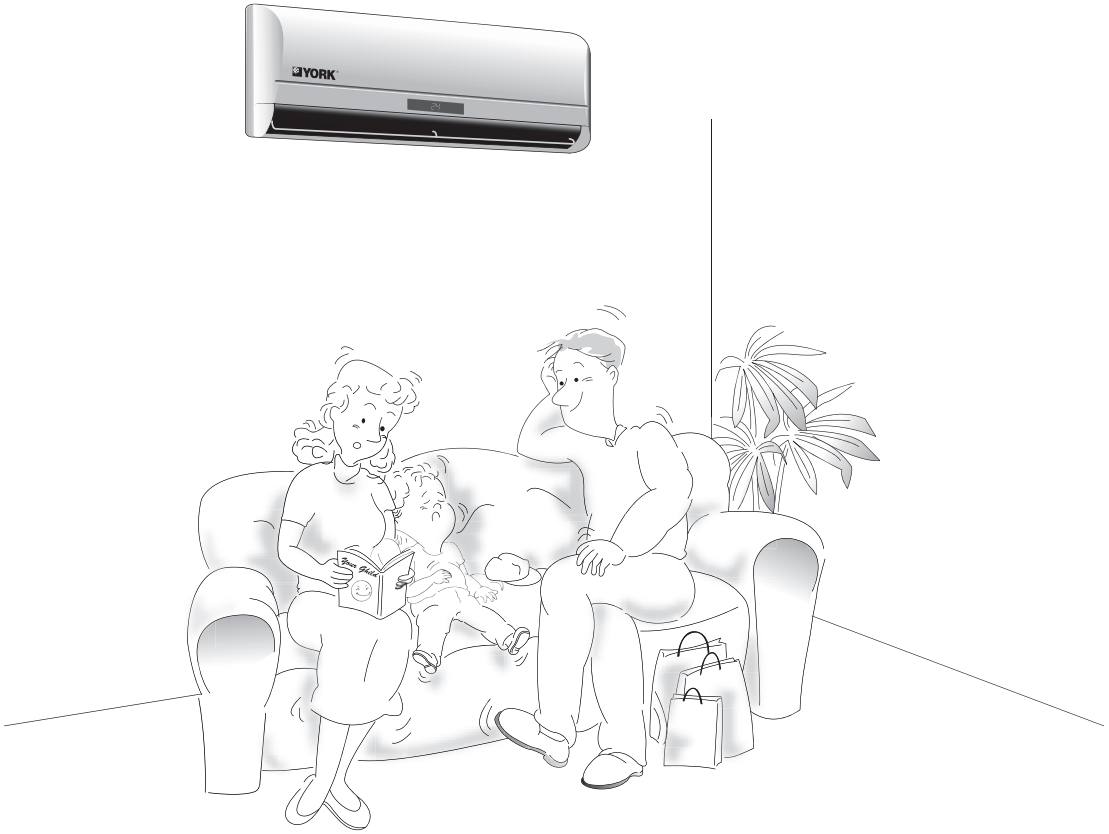

The units comply with one or more of the following marks - see unit for details.

EUROVENT CERTIFIED PERFORMANCE

EN035M80013-000

Please read this installation manual carefully before starting the installation. It will tell you necessary information.

Quality POLICY

We will continuously strive to satisfy our customers with consistent reliability in product, service and support through superior quality, service culture and distinctive technology.

CONTENTS

Safety Precautions 3

Part Names 4

Manual Operation 5

How the air conditioner works 5

Optimal operation 6

Preparation Before Installation 6

Installation Procedure 8

Maintenance 15

Operation tips 16

Trouble Shooting Guide 17

Technical Specification 18

Declaration of conformity 22

	R22 (50 Hz)	R22 (60 Hz)	R407C (50 Hz)	R410A (50 Hz)
Set	MLCAxxFSAAAA	MLCAxxFSAADA	MLCBxxFSAAAA	MACCxxFSAAA
	MLHAxxFSAAAA	MLHAxxFSAADA	MLHBxxFSAAAA	MAHCxxFSAAA
Outdoor	MLDAxxFS-AAA	MLDAxxFS-ADA	MLDBxxFS-AAA	MADCxxFS-AAA
	MLJAxxFS-AAA	MLJAxxFS-ADA	MLJBxxFS-AAA	MAJCxxFS-AAA
Indoor	MLEAxxFS-AAA	MLEAxxFS-ADA	MLEBxxFS-AAA	MAECxxFS-AAA
	MLKAxxFS-AAA	MLKAxxFS-ADA	MLKBxxFS-AAA	MAKCxxFS-AAA

REQUIRED TOOLS

1. Screw driver
2. Hexagonal wrench
3. Torque wrench
4. Spanner
5. Reamer
6. Hole core drill
7. Tape measure
8. Thermometer
9. Manifold gauge
10. Gas leak detector
11. Vacuum pump
12. Pipe clamp
13. Pipe cutter
14. Flare tool set
15. Electrical circuit tester

EXTENDED PARTS

1. Refrigarant Pipe

Models	07-09	12-18	24
Liquid size	1/4 inch	1/4 inch	3/8 inch
Gas size	3/8 inch	1/2 inch	5/8 inch

2. Pipe insulation material (Polyethylene foam 9 mm thick)
3. Vinyl tape
4. Putty

SAFETY PRECAUTIONS

- Please read this installation manual carefully before starting installation of the unit.
- This air conditioning system contains refrigerant under pressure, rotating parts and electrical connection which may be dangerous and can cause injury. Installation and maintenance of this air conditioning system should only be carried out by trained and qualified personnel.
- After unpacking, please check the unit carefully for possible damage.
- Before undertaking any work on the unit, make sure that the power supply has been disconnected.

WARNING & CAUTIONS

INSTALLATION

Do not store or unpack the unit in a wet area or expose to rain or water.

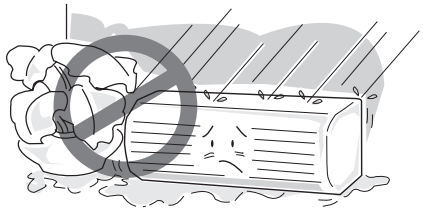

It may cause the unit to short circuit and may result electric shocks or fire.

Do not install in a place where flammable gas may leak.

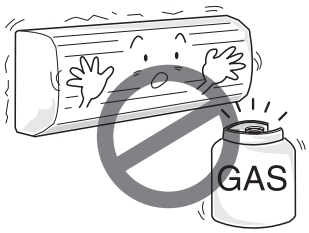

It may cause fire.

Do not conduct installation in wet area or in the rain.

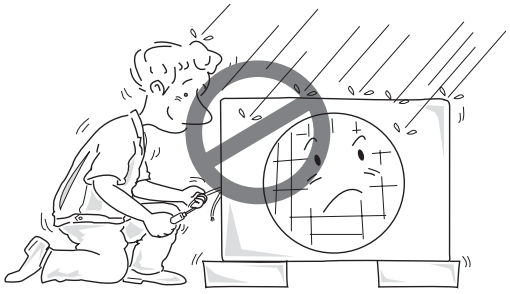

It is a high risk to cause the electrical shocks.

This system is designed for domestic or residential use only.

If used in certain environments, such as a manufacturing workplace, the equipment may not function efficiently.

EN

J199.pmd 3 31/03/2005, 9:53 PM

Preview Limit Reached! To view more of this manual, please visit:
http://freemanualdownload.com/York-MiniSplit-High-Wall-MLCAMLHA0724-free-manual-download